




RIGOLETTO

INSTALLATION TYPE:
RECESSED




	C.V. [V]	LED 1.1W, 110-277V LED 2W, 110-277V		IP 20	025.597 REV02	4205A 4205G 4205B 4205H 4205C 4205L 4205D 4205M 4205E 4205O 4205F
					MADE IN ITALY	

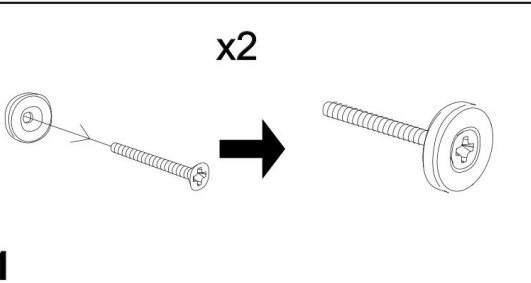

x2

1

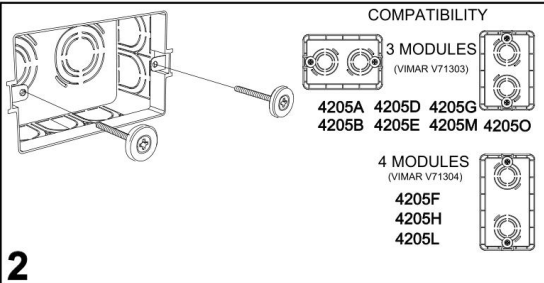

2


COMPATIBILITY

3 MODULES
(VIMAR V71303)


4205A 4205D 4205G
4205B 4205E 4205M 4205O

4 MODULES
(VIMAR V71304)

4205F
4205H
4205L

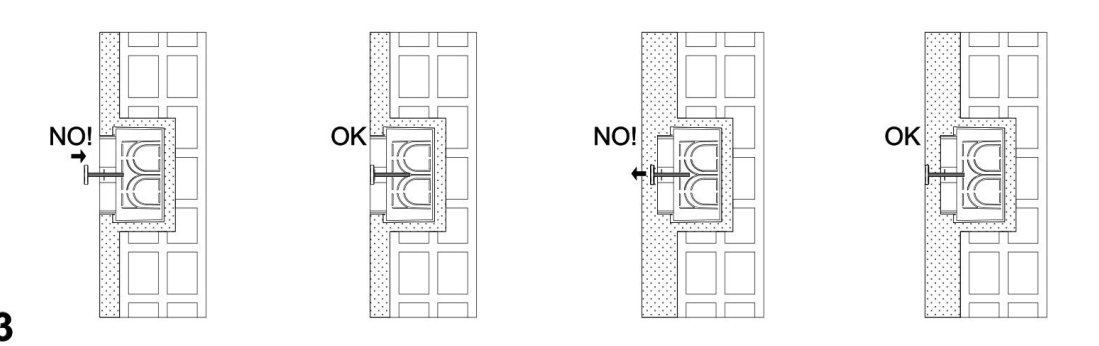



3

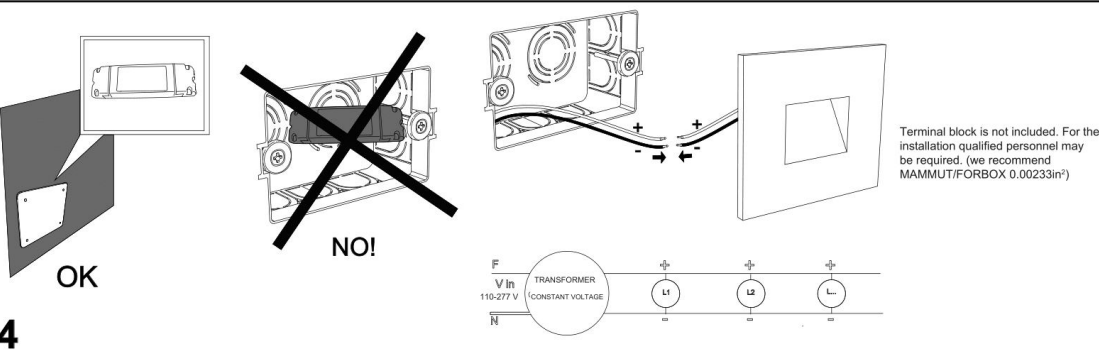

4

Terminal block is not included. For the installation qualified personnel may be required. (we recommend MAMMUT/FORBOX 0.00233in²)



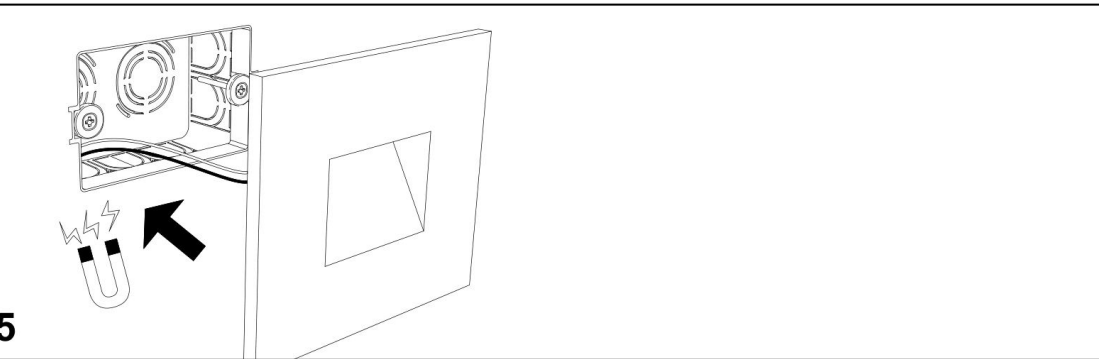

5

sales@gordonbullard.com
www.byiba.com
1 877-964-4646



991 South Gull Lake Dr.
Richland, MI 49083
USA



IMPORTANT

To ensure equipment safety you must carefully follow the instructions below. This leaflet must be kept handy by personnel entrusted with all ordinary and extraordinary maintenance.

- Before any installation or maintenance operation on the bulb, make sure it is disconnected from power
- Fit the correct bulbs, according to the type and power indicated on the lamp data label.
- Make sure the lamp technical features are compatible with the use you are going to make of it.
- Should you have any doubt, refer to the dealer or ask an electrician.
- When connecting to the mains, follow the correct colour code for power cables: (N) blue, (L) brown or black and, only for class I equipment, (T) yellow/green.
- When lamps are to be fitted to the wall directly through their ceramic parts, fasten the fixing screws lightly, to avoid breaking the ceramic.
- To clean the lamp on the outside, use a soft cloth, possibly wet. Do not use solvents or abrasive products. No liquid must get in contact with the lamp interior parts.
- Do not touch the equipment with dirty hands.



= Class I equipment, must be connected to an earth terminal.



= Double insulated lamp, does not need earthing.



= Electrical equipment in class III, electrical safety guaranteed by low voltage tension, does not require grounding



= Minimum distance to be observed from all lit up objects.



= Replace immediately the safety glass, if damaged, with the original part.



= The lamp uses low pressure bulbs, and needs no protection glass.



= The equipment at the end of its life must be collected separately from other waste.