


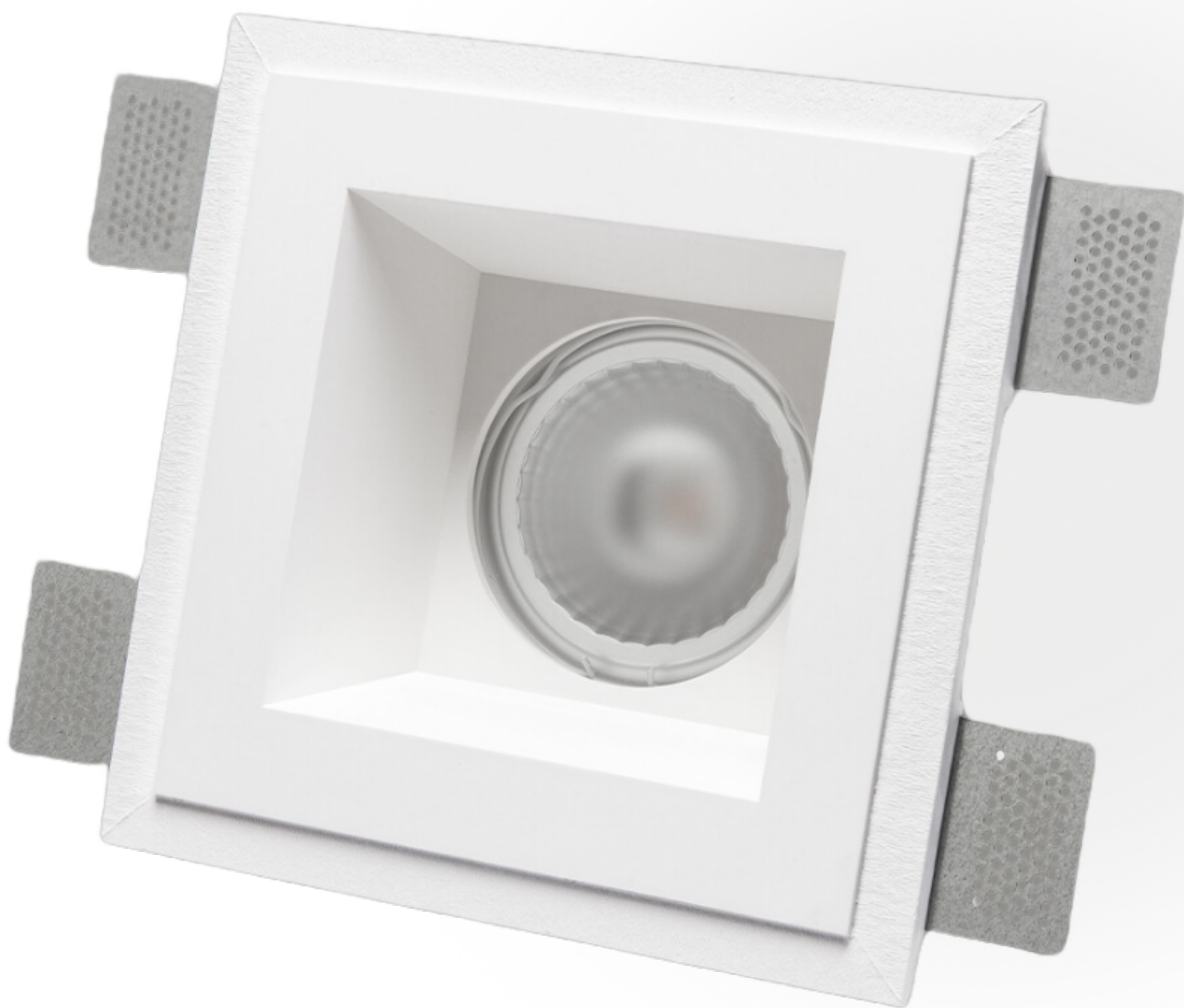

REGOLO

INSTALLATION TYPE:
CEILING-MOUNTED

GU10

LED



IP20



025.552^(REV03)

MADE IN ITALY

4039B

4040B

4044B

4045B

4044C

4045C

8935M

C.C.
[m.A.]

LED

6,5W 350mA

13W 700mA

LED

III

GU10

IP 20

IP 20/IP 44

GU10 Ø4,37"

MAX 20W 120V

NO!

* in

* Art.		
4039B	10.43" x 10.43"	LED: 5.71" GU10: 5.31"
4040B	10.43" x 10.43"	LED: 5.71" GU10: 5.31"
4044B	8.07" x 8.07"	LED: 4.13" GU10: 4.53"
4044C	7.48" x 7.48"	LED: 3.35" GU10: 3.54"
4045B	10.04" x 10.04"	LED: 6.69" GU10: 7.09"
4045C	8.07" x 8.07"	LED: 4.33" GU10: 4.53"
8935M	12.20" x 12.20"	LED: 2.95" GU10: 3.35"

= 0.49"

= 0.98"

2

LED

3

4

5

6

7

8

9

LED

Terminal block is not included. For the installation qualified personnel may be required. (we recommend MAMMUT/FOR-BOX 0.0023 in")

10a

GU10

10b

11

12

ONLY FOR 4044B

13a

90°

14a

ONLY FOR 4045B

13b



IMPORTANT

To ensure equipment safety you must carefully follow the instructions below. This leaflet must be kept handy by personnel entrusted with all ordinary and extraordinary maintenance.

- Before any installation or maintenance operation on the bulb, make sure it is disconnected from power
- Fit the correct bulbs, according to the type and power indicated on the lamp data label.
- Make sure the lamp technical features are compatible with the use you are going to make of it.
- Should you have any doubt, refer to the dealer or ask an electrician.
- When connecting to the mains, follow the correct colour code for power cables: (N) blue, (L) brown or black and, only for class I equipment, (T) yellow/green.
- When lamps are to be fitted to the wall directly through their ceramic parts, fasten the fixing screws lightly, to avoid breaking the ceramic.
- To clean the lamp on the outside, use a soft cloth, possibly wet. Do not use solvents or abrasive products. No liquid must get in contact with the lamp interior parts.
- Do not touch the equipment with dirty hands.



= Class I equipment, must be connected to an earth terminal.



= Double insulated lamp, does not need earthing.



= Electrical equipment in class III, electrical safety guaranteed by low voltage tension, does not require grounding



= Minimum distance to be observed from all lit up objects.



= Replace immediately the safety glass, if damaged, with the original part.



= The lamp uses low pressure bulbs, and needs no protection glass.



= The equipment at the end of its life must be collected separately from other waste.